
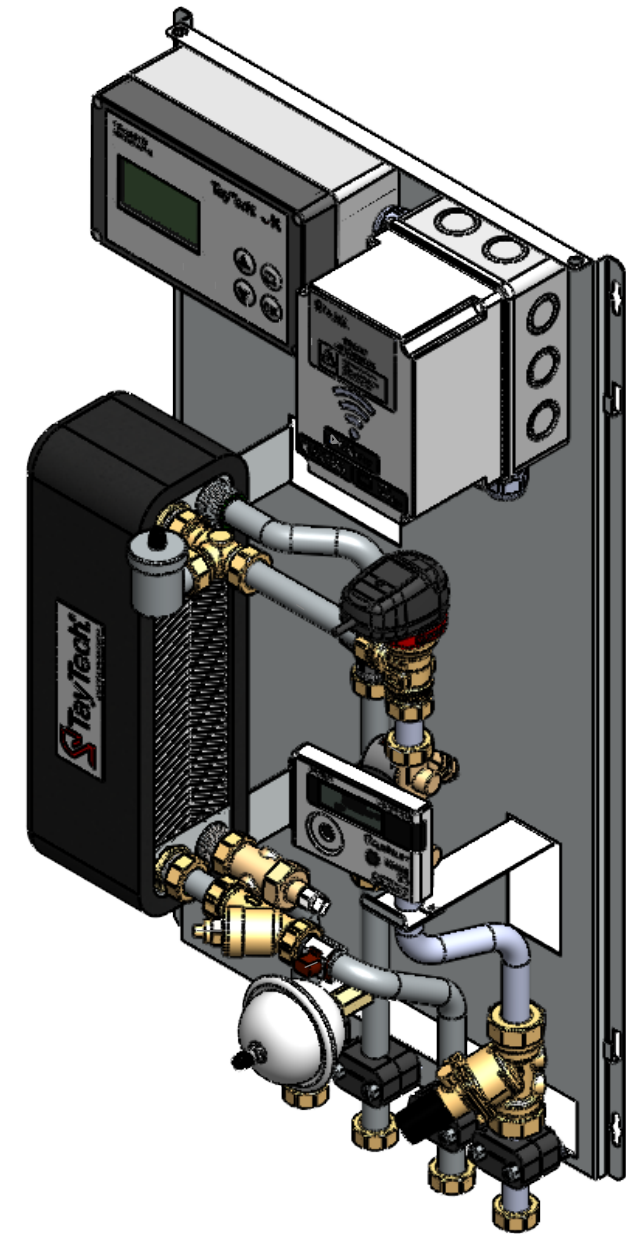
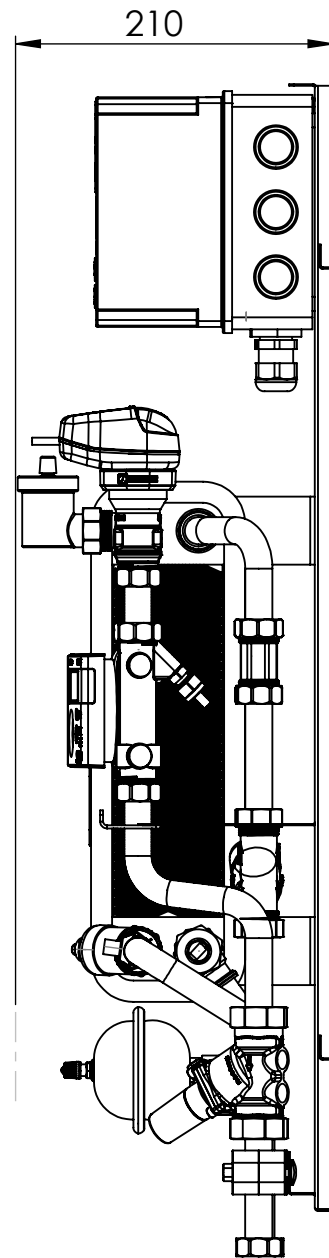


Dikkat

Caution
1- Do not measure the image with a measuring device.
2- Images of formulas or analyses are for technical review.
3- No one other than the person who checked the image may change the image.

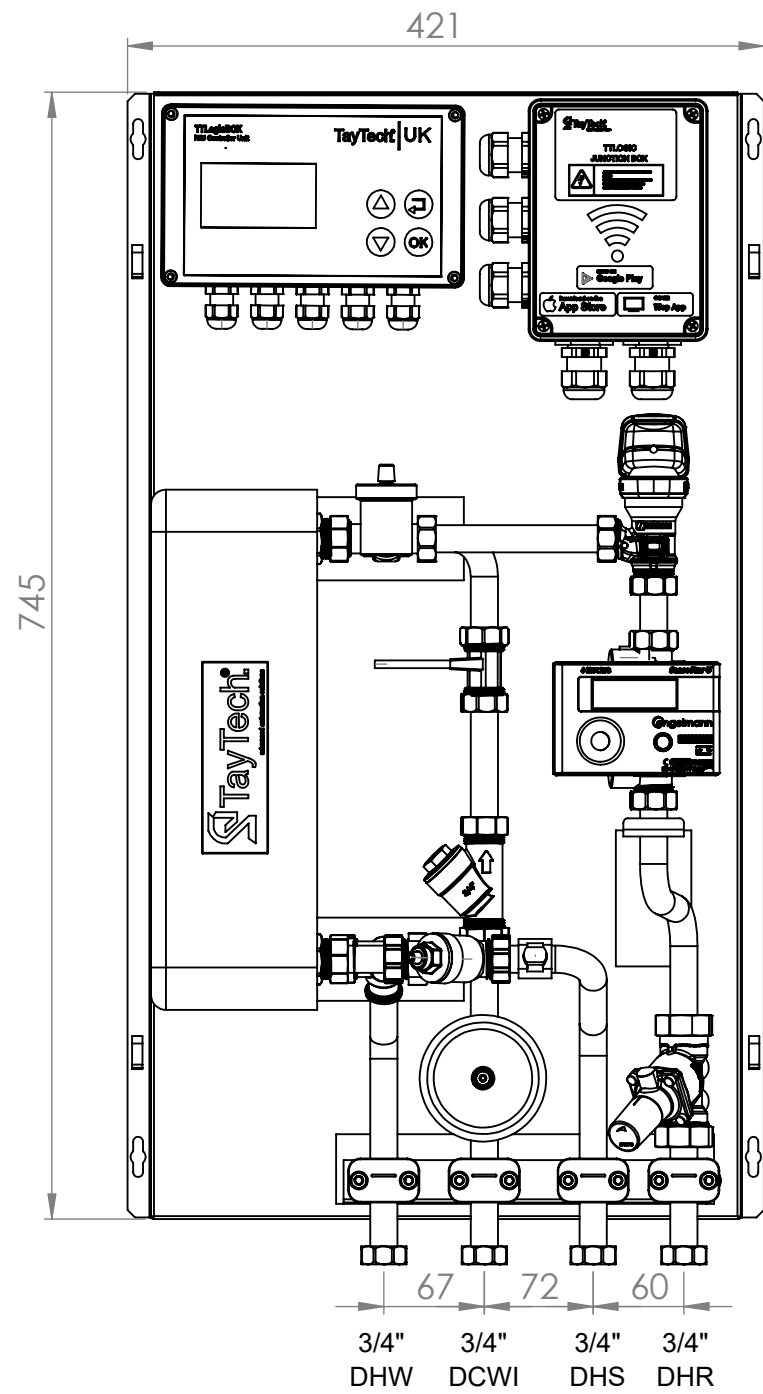

KD	Kazan Dönüş	DHR	District Heating Return
KG	Kazan Giriş	DHS	District Heating Supply
SSG	Soğuk Su Giriş	DCWI	Domestic Cold Water Inlet
SSÇ	Soğuk Su Çıkış	DCWO	Domestic Cold Water Outlet
KSSÇ	Kullanım Sıcak Suyu Çıkış	DHW	Domestic Hot Water
YIG/IG	Isıtma Gidiş	SHS	Space Heating Supply
YID/ID	Isıtma Dönüş	SHR	Space Heating Return
MSG	Merkezi Soğutma Giriş	CCS	Central Cooling Supply
MSD	Merkezi Soğutma Dönüş	CCR	Central Cooling Return
DSG	Daire Soğutma Giriş	SCS	Space Cooling Supply
DSD	Daire Soğutma Dönüş	SCR	Space Cooling Return
Re-S	Re-Sirkülasyon	Re-C	Re-Circulation

NAME / İSİM	SIGNATURE / İMZA	DATE / TARİH	REVİZE NU.	 advanced automation solutions İnönü Mahallesi, Atatürk Bulvarı, No:7/2, 41400, İnönü Gebze Plastikçiler Osib/Gebze/Kocaeli	
DRAWER / ÇİZEN	M.KARADENİZ	1.12.2025	02		
CHECKED / KONTROL					
APPROVED / ONAY					
PRODUCT GROUP / ÜRÜN GRUBU				TITLE / BAŞLIK	
DIRECT SMARTEXA DHW				D-S-UK-DHW_U0A4	
DRAWING NO / ÇİZİM NU.				A3	
WEIGHT / AĞIRLIK:				PAGE / SAYFA: 1 / 1	
SCALE / ÖLÇEK:.....				TT-VIAR-TR01 Revizyon No: 02 Tarih:26.04.2023	